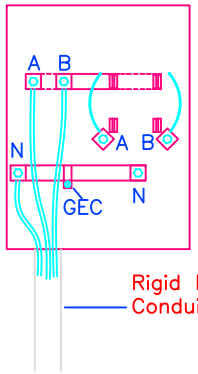

NOTE:

JEC enters left-hand side of Urd meter base only! Suitable disconnect furnished by owner is to be located on the right-hand side of the meter base only!

Local Inspectors

Burke: 706-554-8758
Columbia: 706-868-3420
Emanuel: 478-237-6514
Glascock: 706-598-2811
Jefferson: 478-625-4032
Jenkins: 478-982-2563
Johnson: 478-484-8978
McDuffie: 706-595-5355
Richmond: 706-312-5050
Warren: 706-465-0310
Washington: 912-552-2937

Notes:

1: Service point to be located by JEC personnel **in all cases.**
2: Depth of trench shall be inspected prior to cable installation.
3: Failure to meet proper depths or service point locations can prolong service hookup.
4: All wiring shall be in accordance with the National Electrical Code, local, and or JEC specifications.
5: From meter installation to mobile home should be 30' max to 4' min.
6: Conduit to extend outside any concrete areas. (Driveways & footings)
7: All 320A meter bases must have a lever by-pass

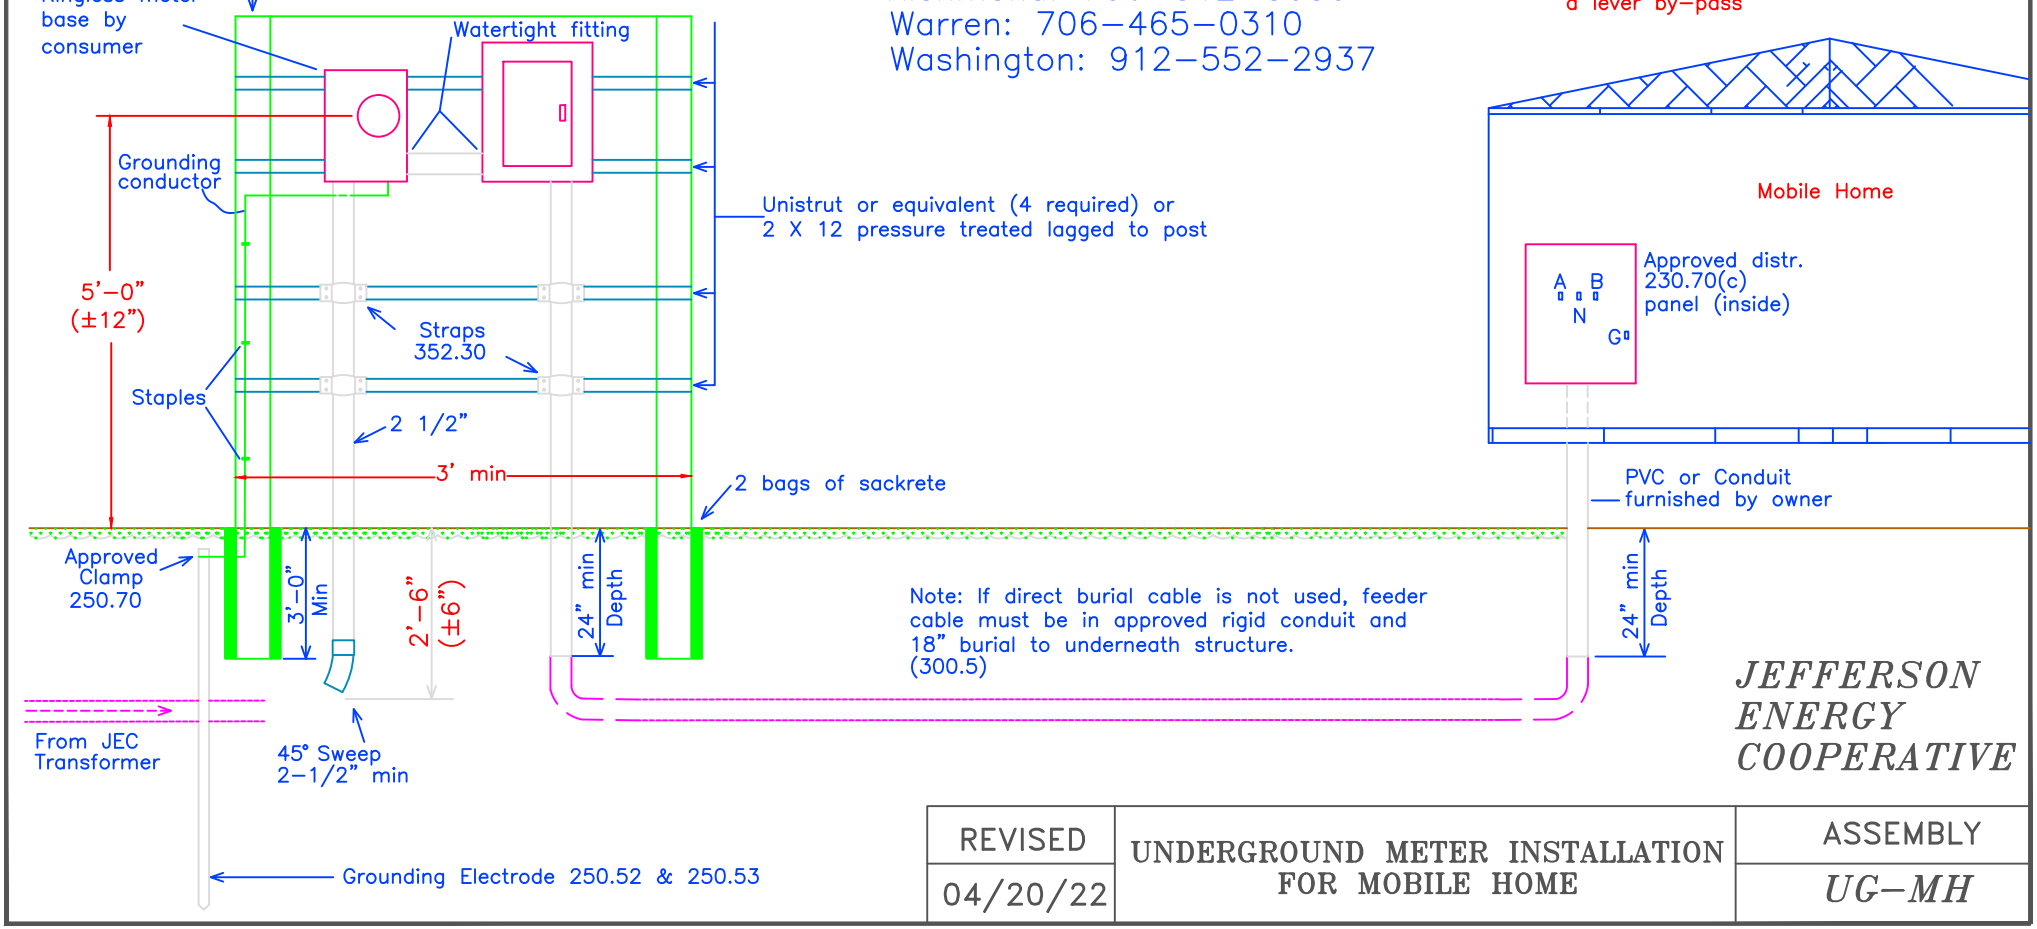

JEFFERSON ENERGY COOPERATIVE

REVISED	UNDERGROUND METER INSTALLATION FOR MOBILE HOME	ASSEMBLY
04/20/22		UG-MH