


**NOTE:**

JEC enters left-hand side of Urd meter base only!  
 Suitable disconnect furnished by owner, is to be located to the right of meter socket or under socket without interfering with service conduit.

Ringless meter base installed by consumer

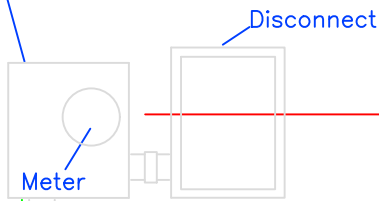

Local Inspectors

- Burke: 706-554-8758
- Columbia: 706-868-3420
- Emanuel: 478-237-6514
- Glascocock: 706-598-2811
- Jefferson: 478-625-4032
- Jenkins: 478-982-2563
- Johnson: 478-484-8978
- McDuffie: 706-595-5355
- Richmond: 706-312-5050
- Warren: 706-465-0310
- Washington: 912-552-2937

Grounding conductor (See Table 1) Must be protected by approved means. 250.64(b) 250.92(b)

Conduit straps as required 352.30

Approved clamp 250.70

See Note: 4

45° Sweep 2 1/2" min

Grounding Electrode 250.52 & 250.53

5'-0" (±12")

2'-6" (±6")

**NOTES:**

- 1: Service point to be located by JEC personnel **in all cases.**
- 2: All wiring shall be inspected prior to connection by JEC.
- 3: All wiring shall be in accordance with the National Electrical Code, local, and or JEC specifications.
- 4: Conduit to extend outside any concrete areas. (Driveways & footings)
- 5: All 320A meter bases must have a lever by-pass

If mounting service equipment to Mobile Home, check with local inspector for approval. An outside disconnect of suitable means shall be used.

**JEFFERSON  
 ENERGY  
 COOPERATIVE**

**RESIDENTIAL  
 UNDERGROUND METER BASE**

REVISED  
 04/18/22

SCALE: 1" = 2.5ft.

ASSEMBLY  
 UG-MB