


NOTE:
 JEC enters left-hand side of Urd meter base only! Suitable disconnect furnished by owner is to be located on the right-hand side of the meter base only!


Suitable single throw, solid neutral, rain tight disconnect switch with fuses or circuit breakers by owner. [230.70(c)]

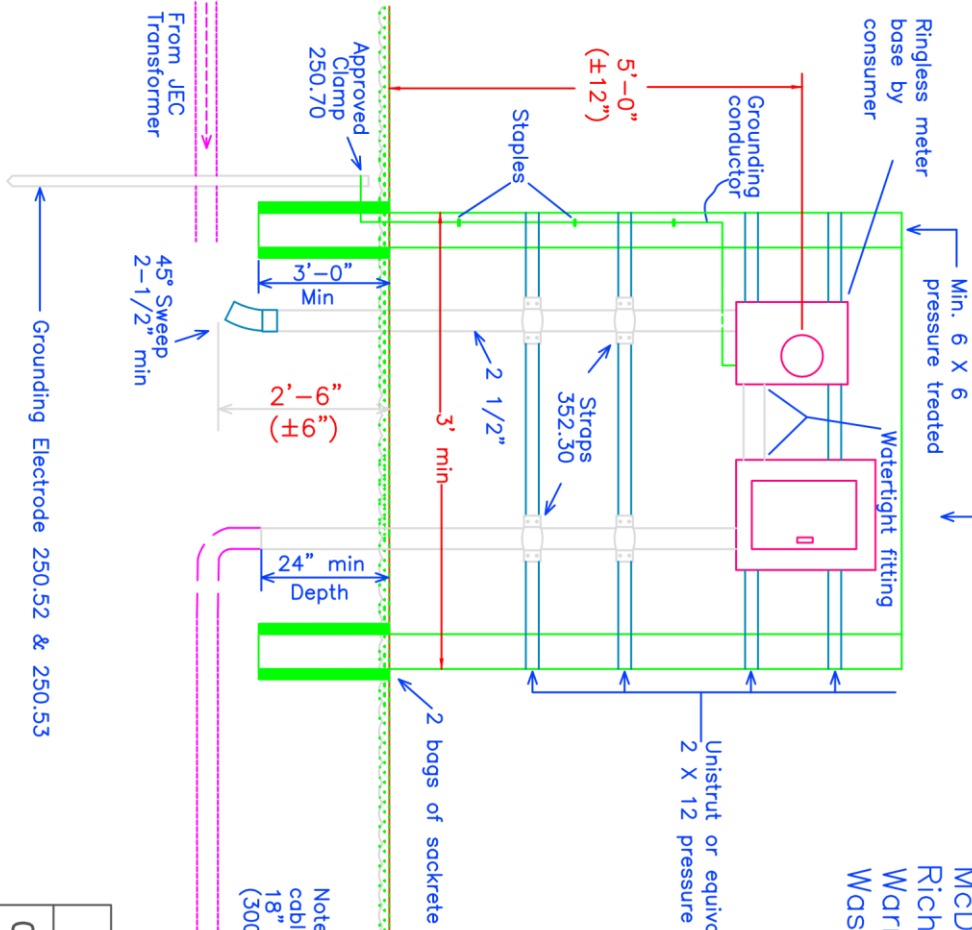

- Local Inspectors**
- Burke: 706-554-8758
 - Columbia: 706-868-3420
 - Emanuel: 478-237-6514
 - Glascok: 706-598-2811
 - Jefferson: 478-625-4032
 - Jenkins: 478-982-2563
 - Johnson: 478-484-8978
 - McDuffie: 706-595-5355
 - Richmond: 706-312-5050
 - Warren: 706-465-0310
 - Washington: 912-552-2937

Note: If direct burial cable is not used, feeder cable must be in approved rigid conduit and 18" burial to underneath structure. (300.5)

- Notes:**
- 1: Service point to be located by JEC personnel in **all cases**.
 - 2: Depth of trench shall be inspected prior to cable installation.
 - 3: Failure to meet proper depths or service point locations can prolong service hookup.
 - 4: All wiring shall be in accordance with the National Electrical Code, local, and or JEC specifications.
 - 5: From meter installation to mobile home should be 30' max to 4' min.
 - 6: Conduit to extend outside any concrete areas. (Driveways & footings)
 - 7: All 320A meter bases must have a lever by-pass

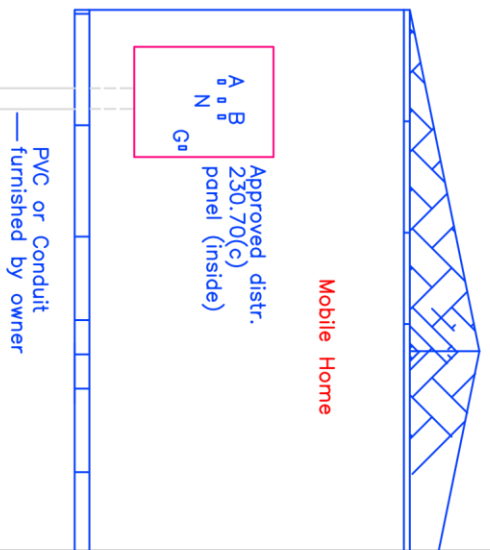

JEFFERSON ENERGY COOPERATIVE

REVISED	UNDERGROUND METER INSTALLATION FOR MOBILE HOME	ASSEMBLY
04/20/22		UG-MH

Grounding Electrode 250.52 & 250.53